



平面図 S=1:250
(1工区)

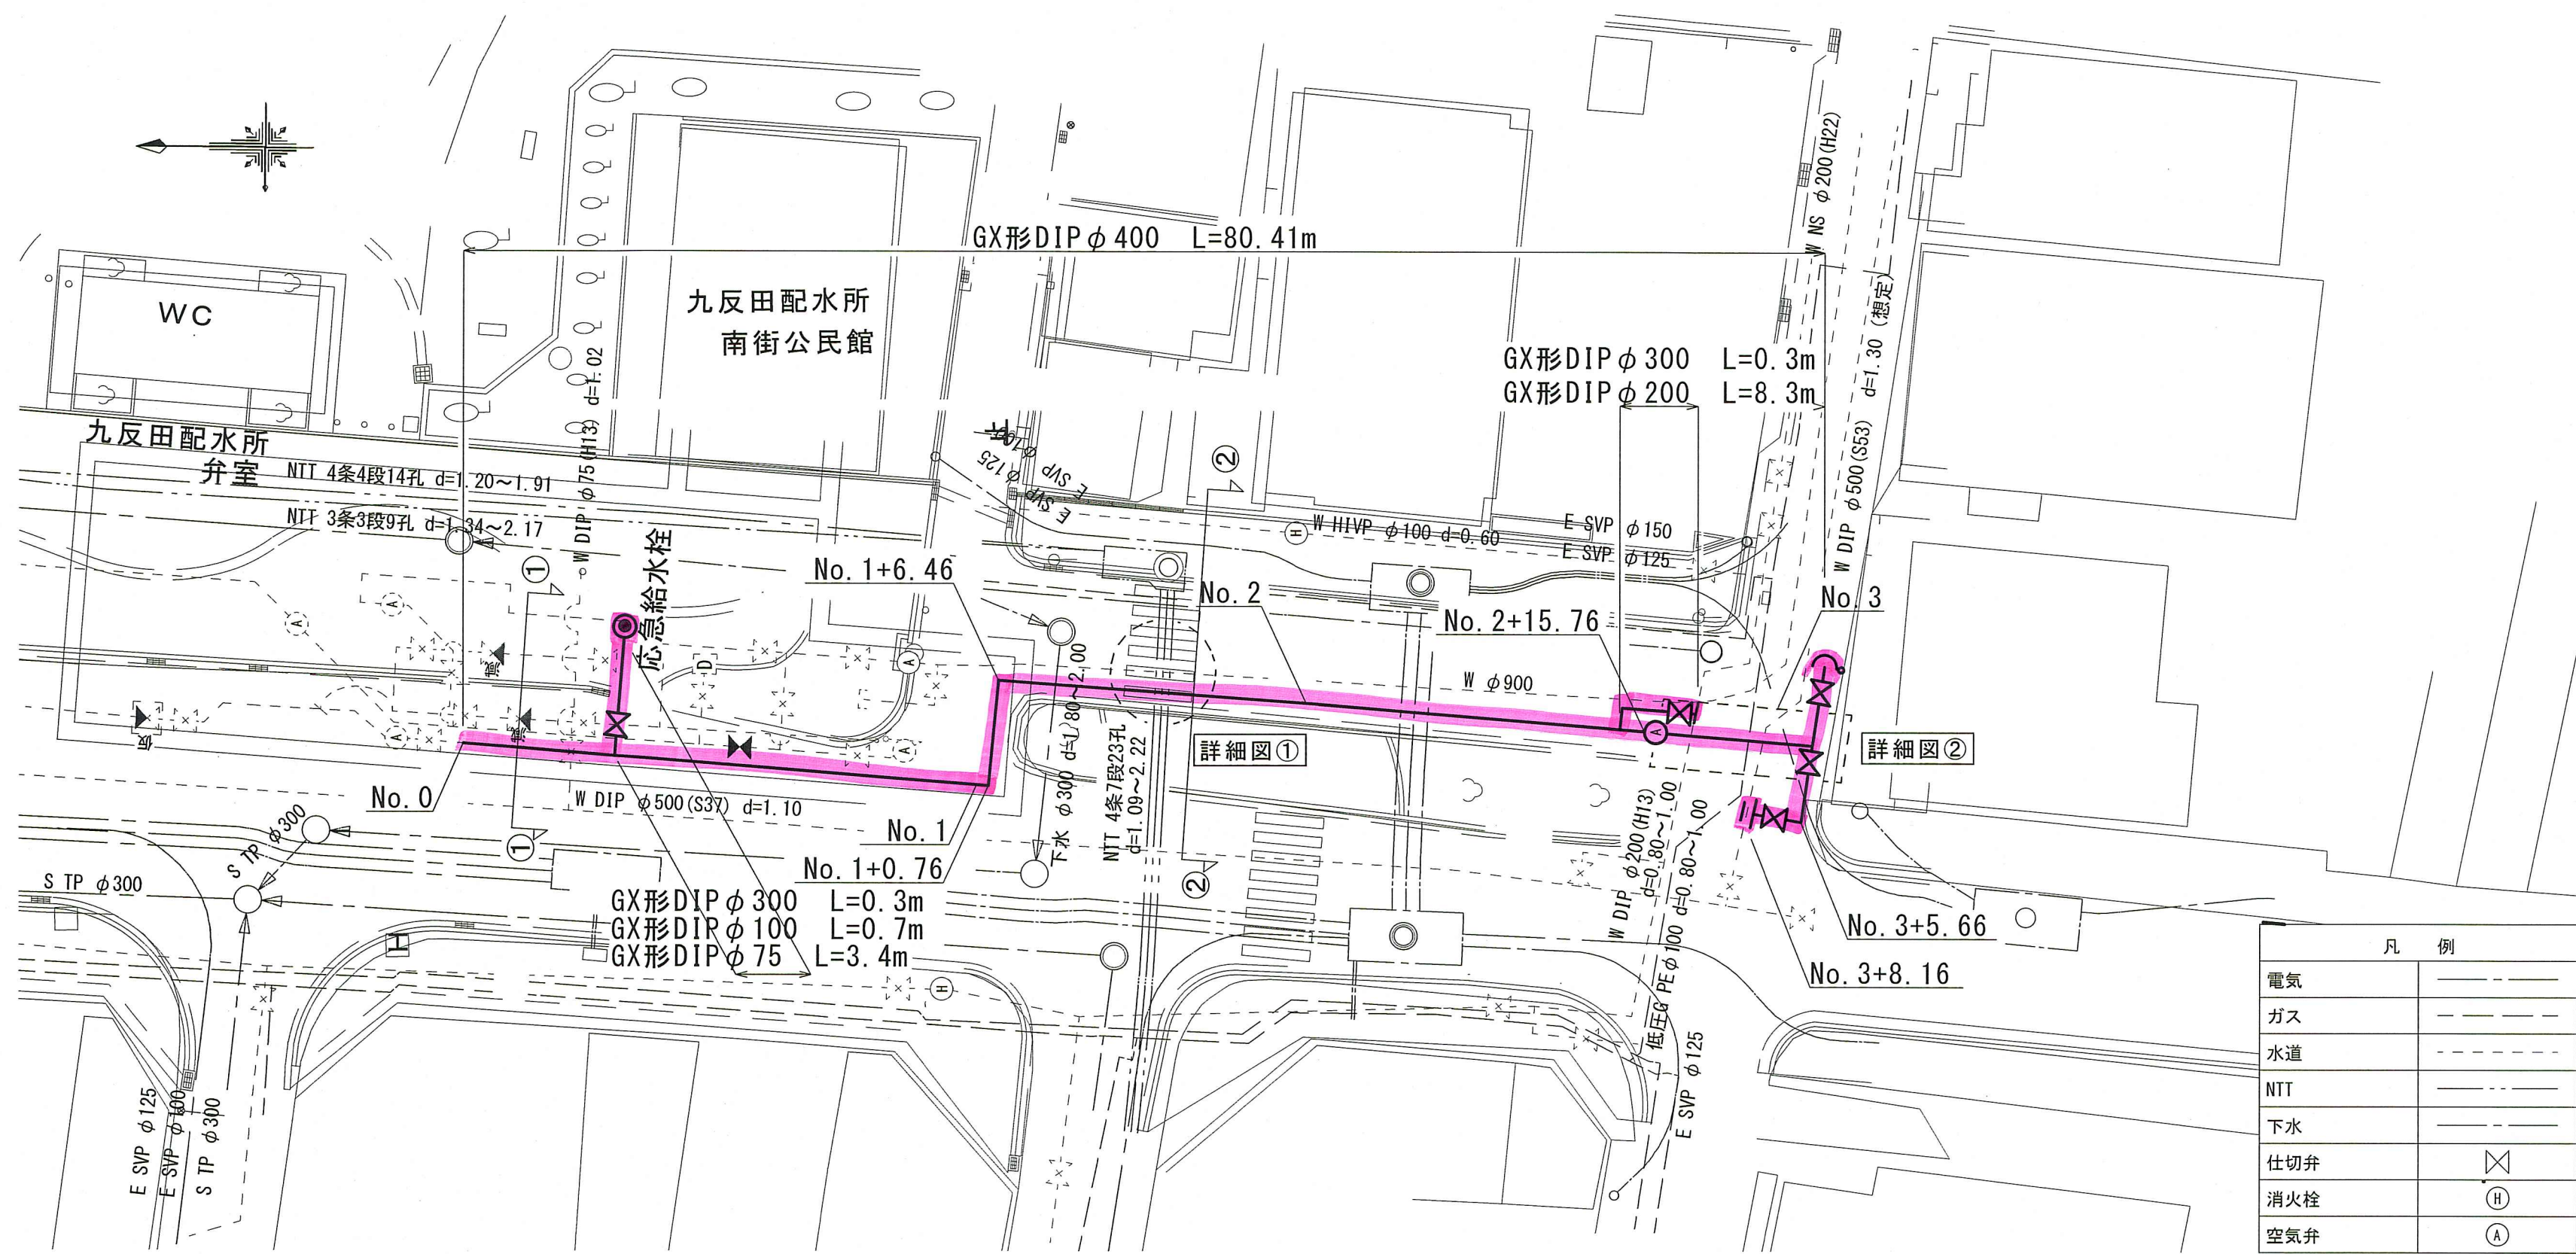


凡 例	
電気	———
ガス	———
水道	———
NTT	———
下水	———
仕切弁	⊗
消火栓	⊕
空気弁	⊙

縦断面図
V=1:100
H=1:200
(1工区)

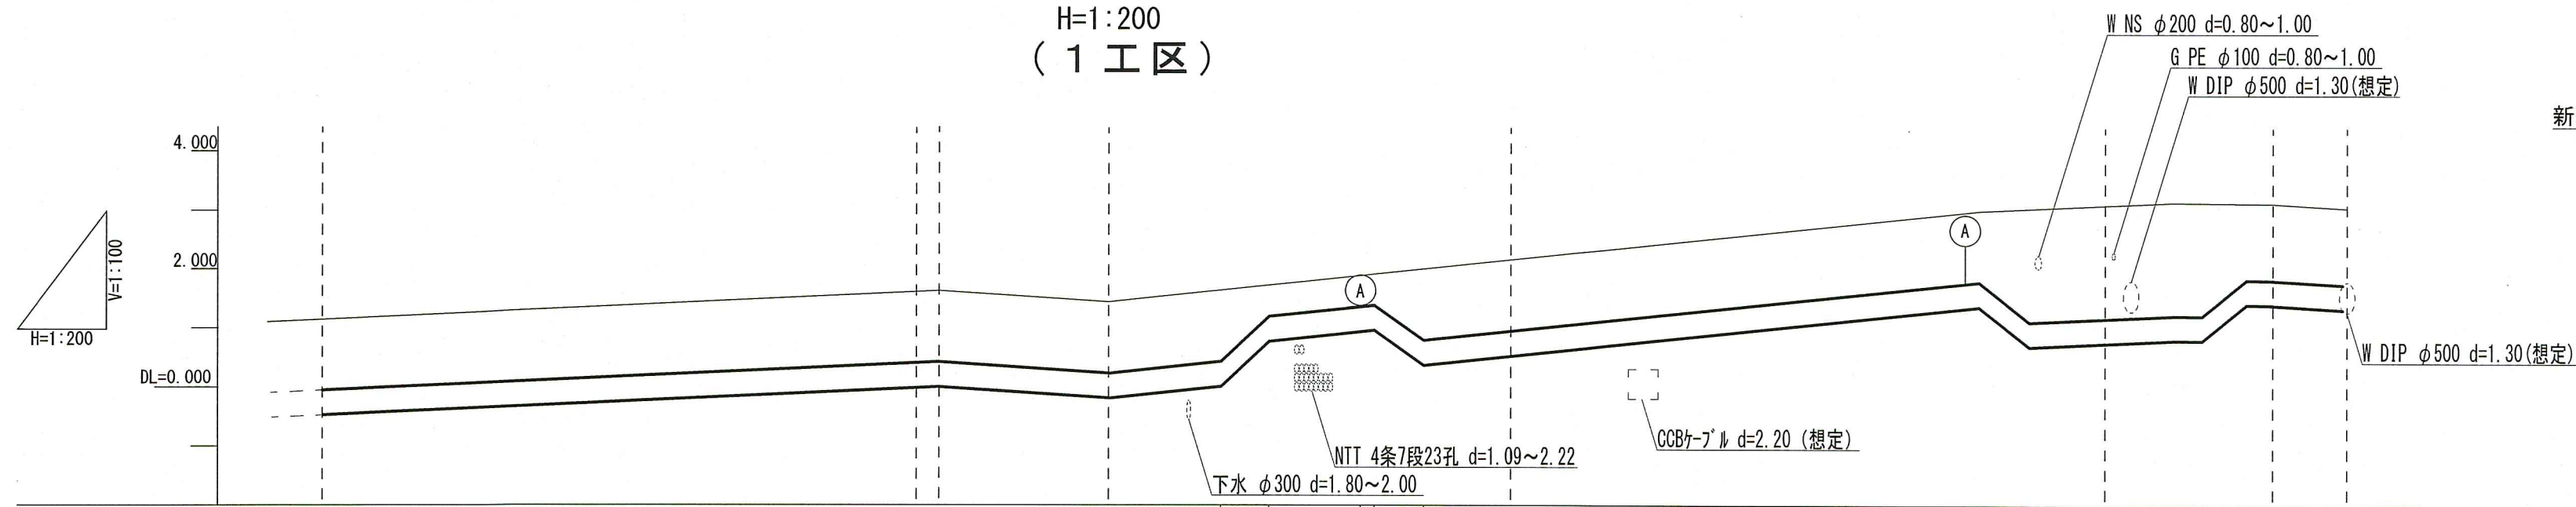


管種・口径	GX形DIP φ400													
土被り	1.200													
地盤高	1.147													
管中心高	-0.266													
単距離	0.000													
追加距離	0.000													
測点	No. 0													


位置図 S=1:5000

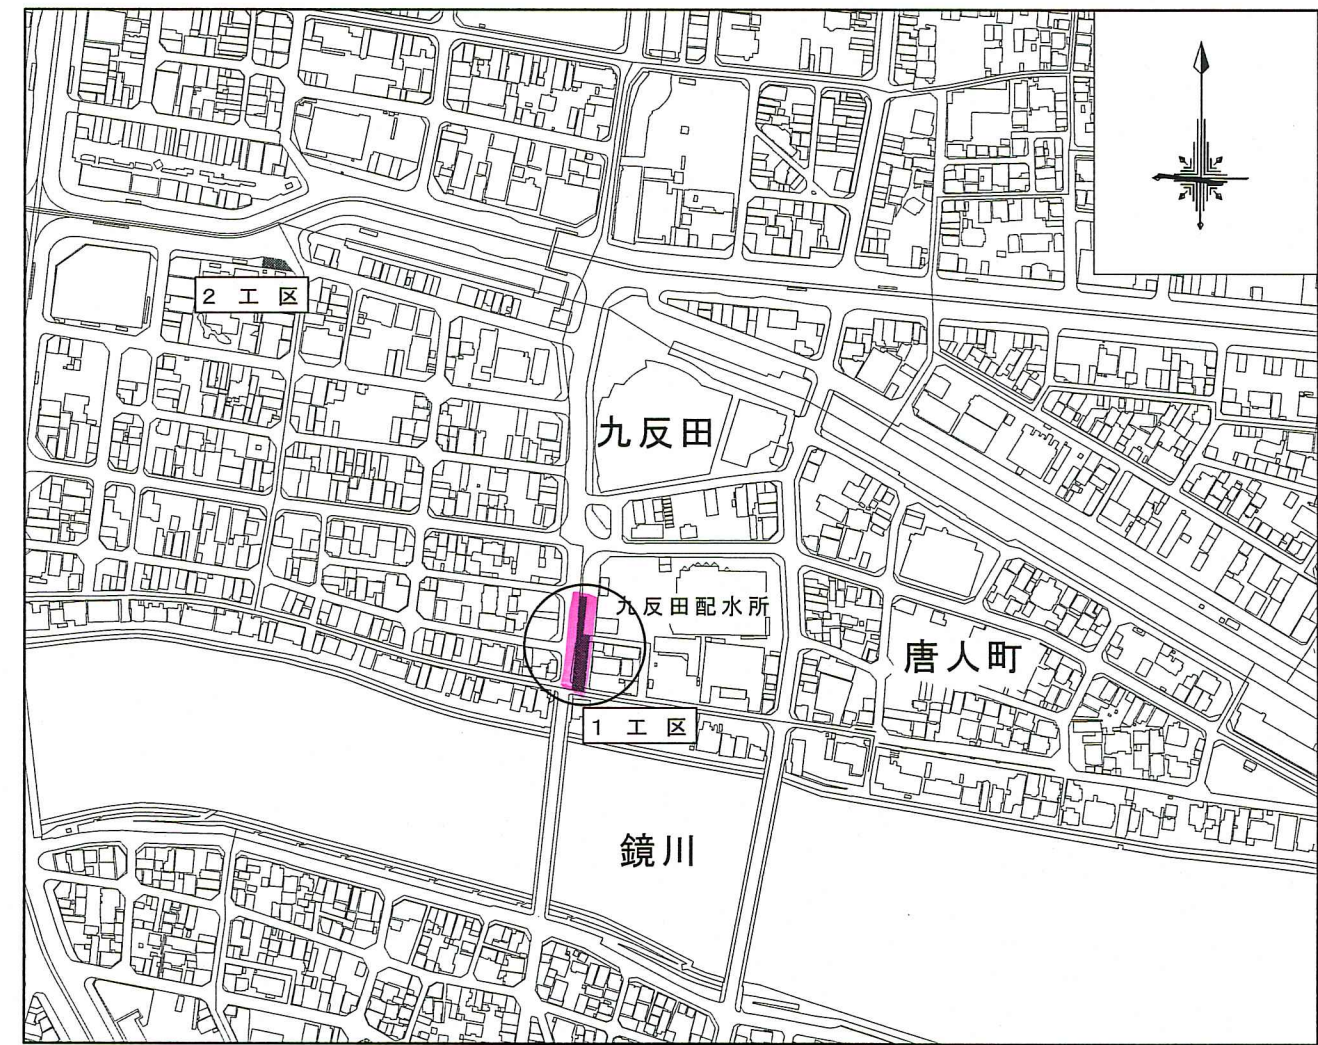


横断面図 S=1:100

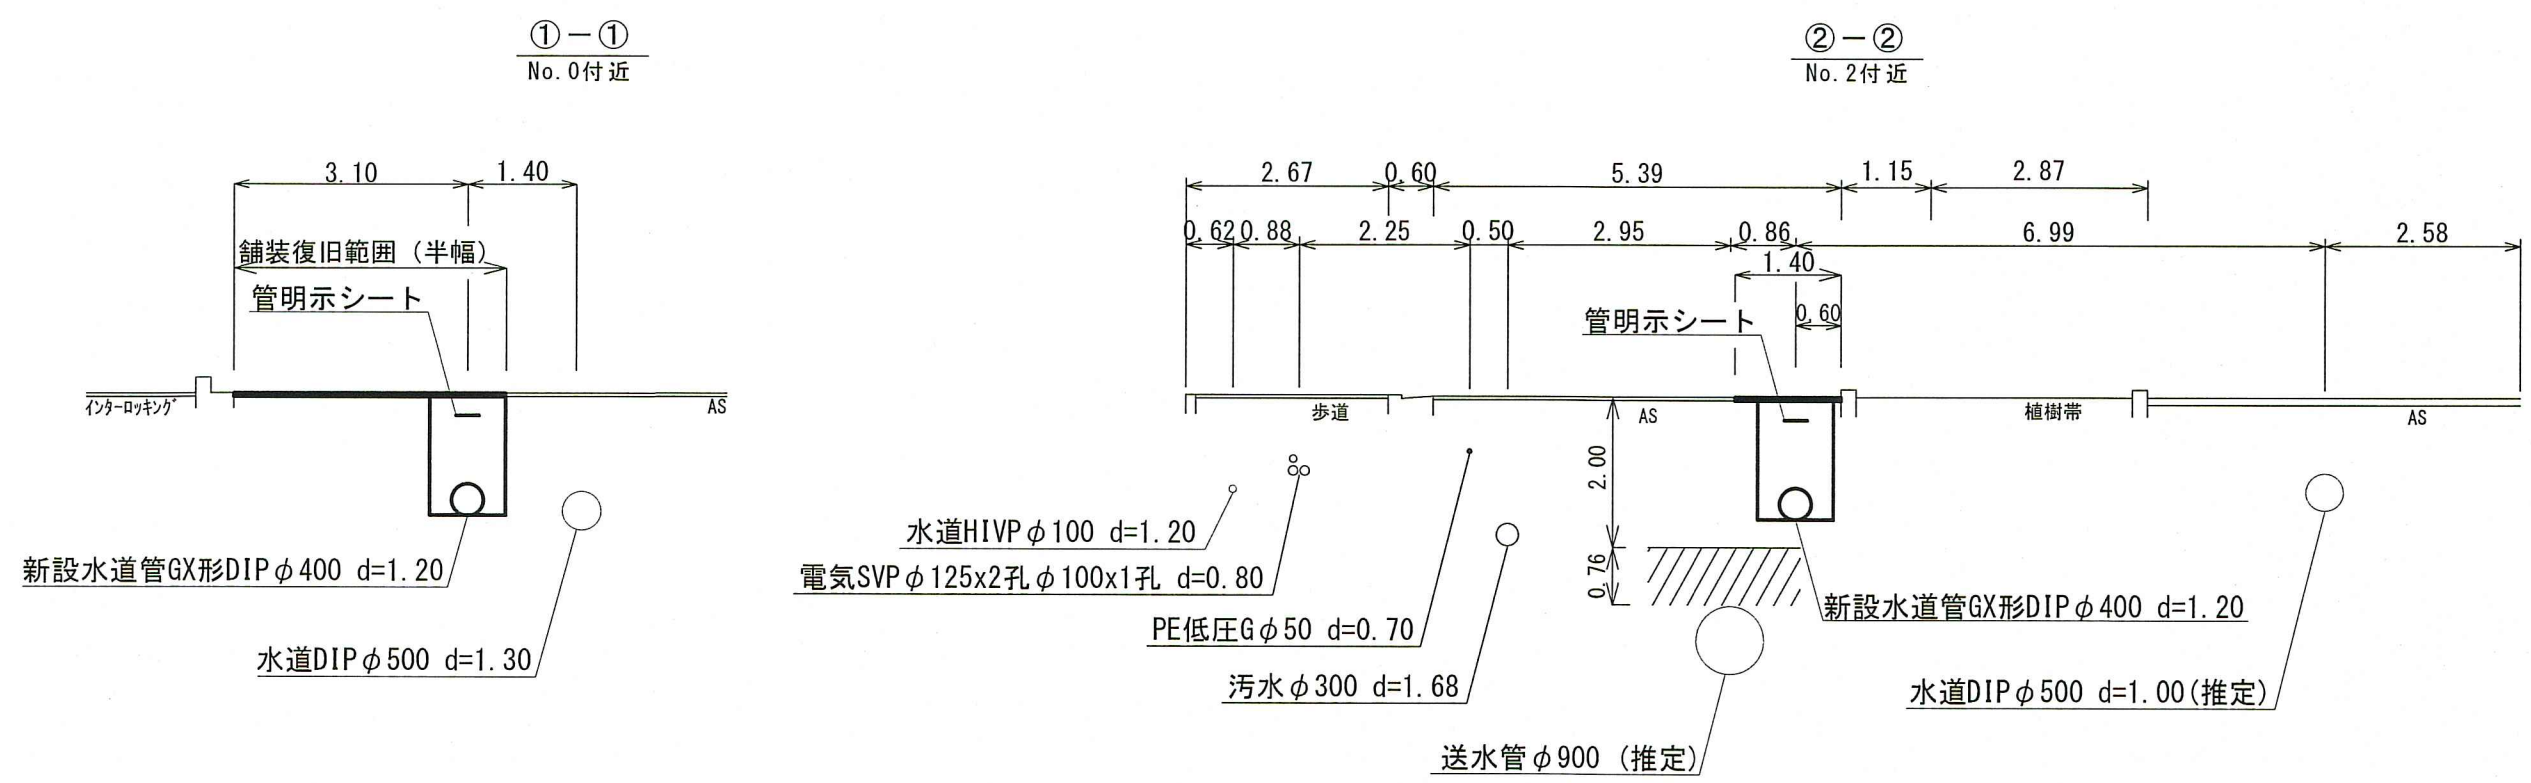


詳細図 S=Free

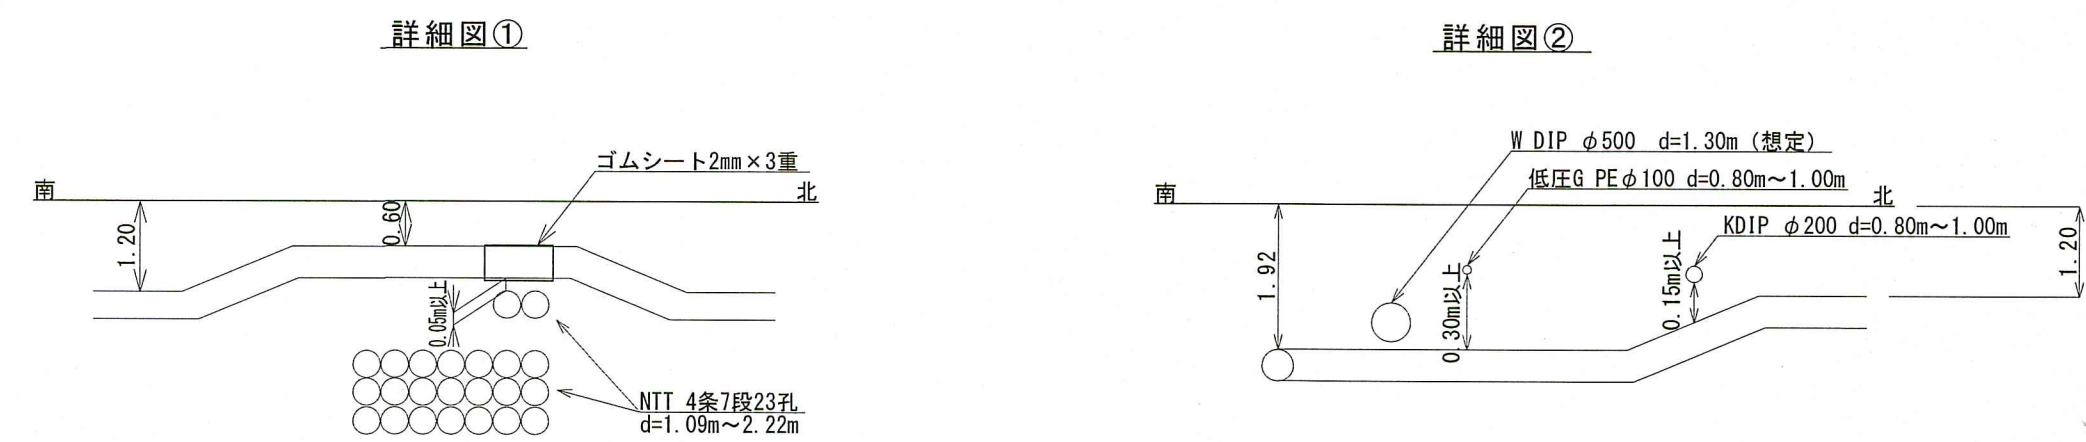


位置図 S=1:5000

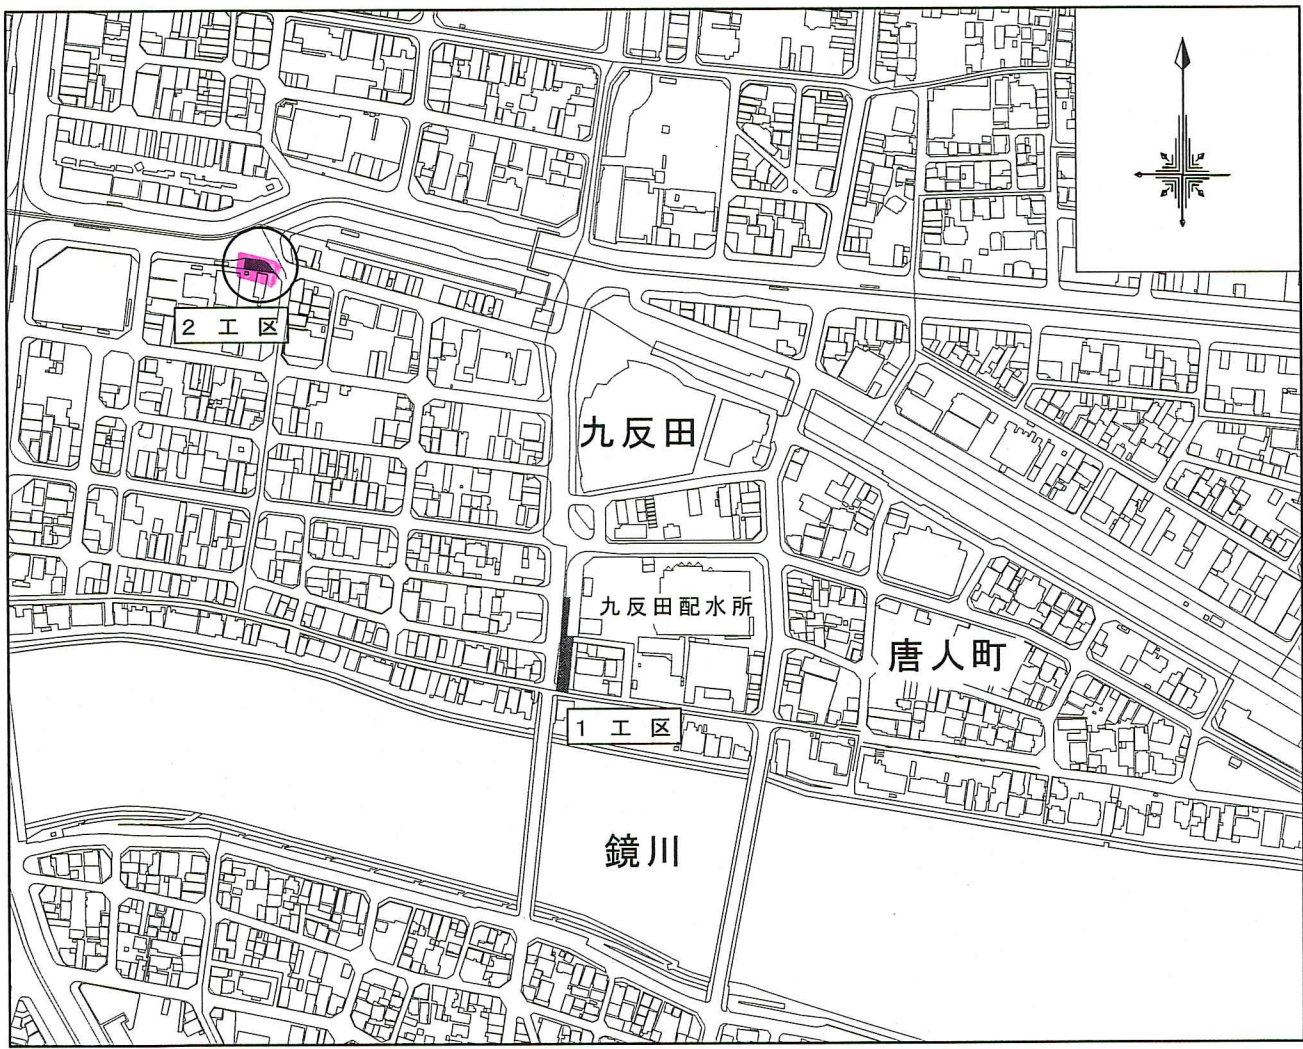


平面図 S=1:250
(2工区)

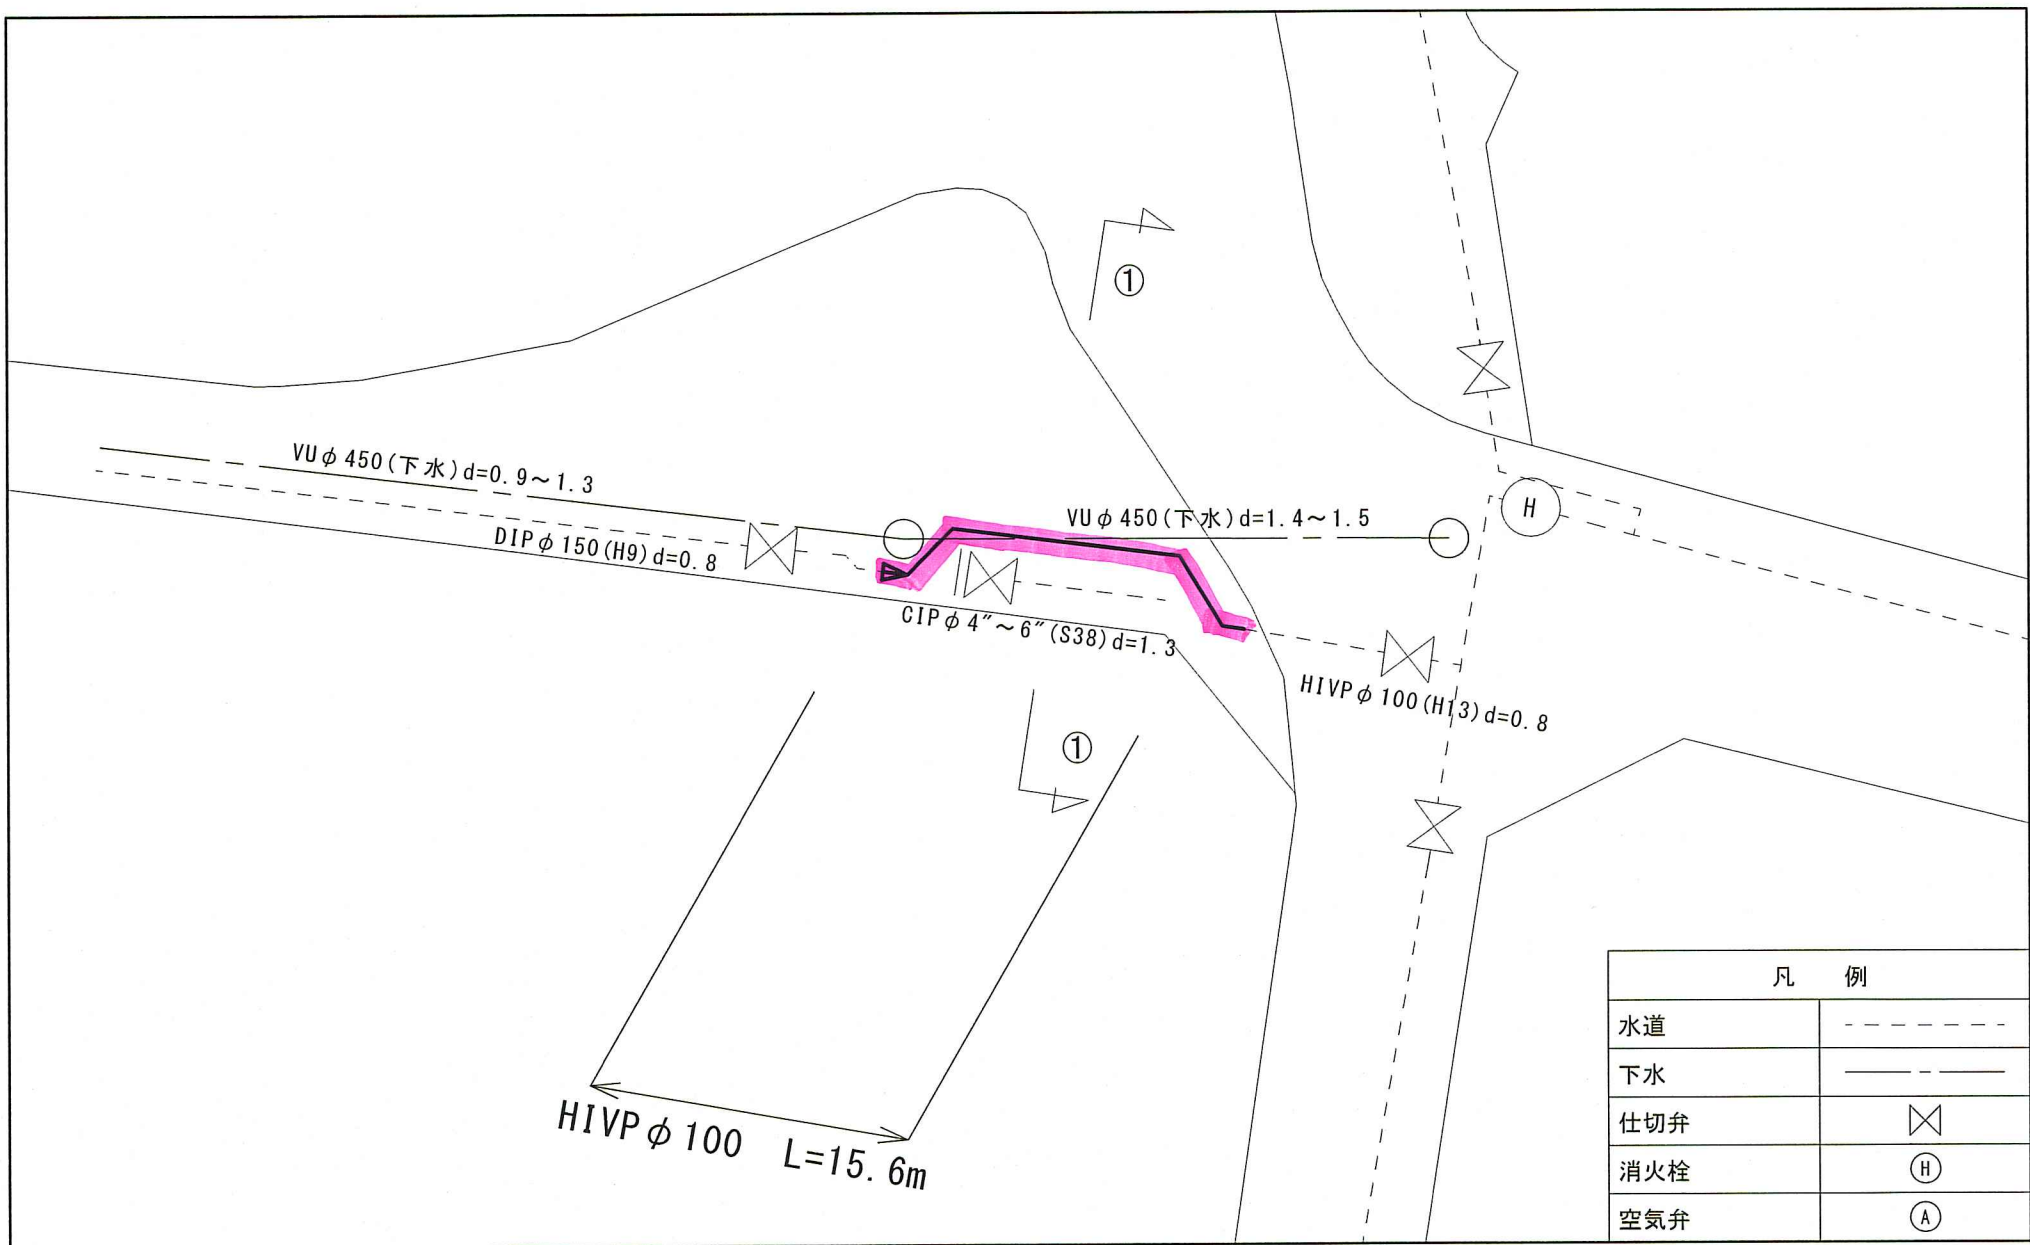


横断面図 S=1:50

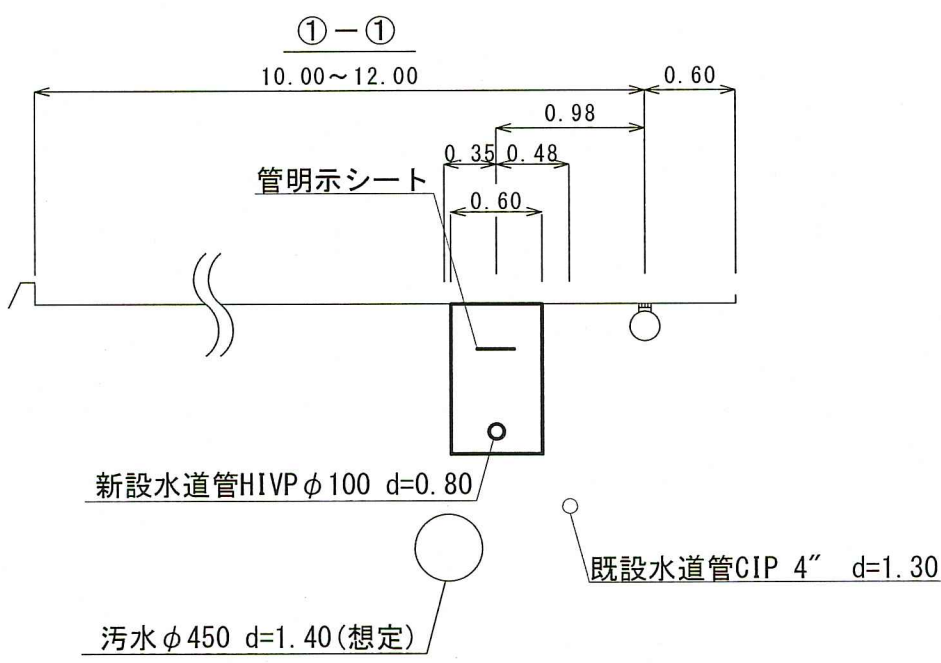

廃止管平面図 S=1:500
(2工区)

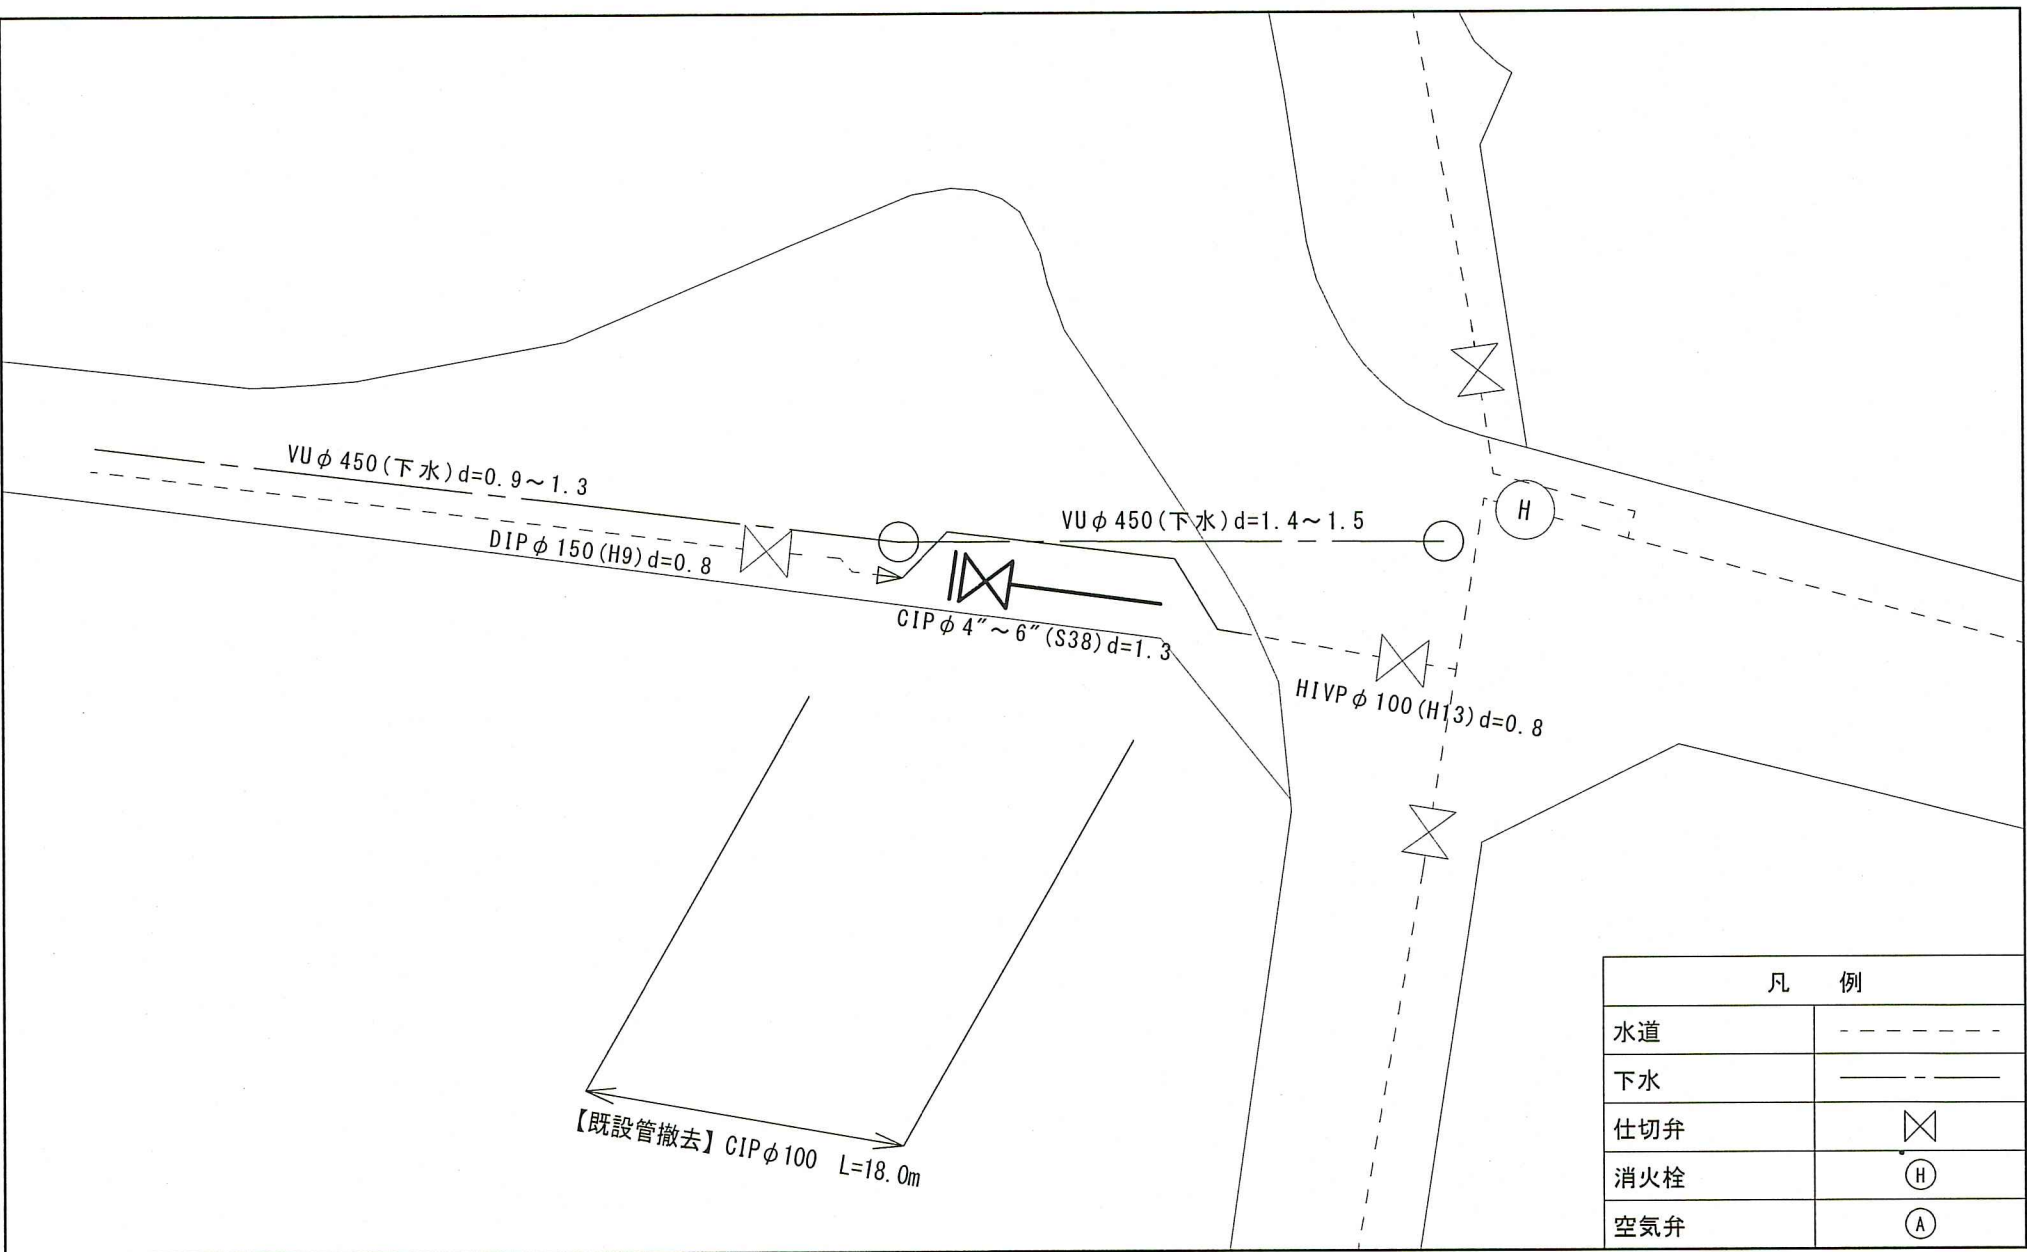


給水切替平面図 S=1:500
(2工区)

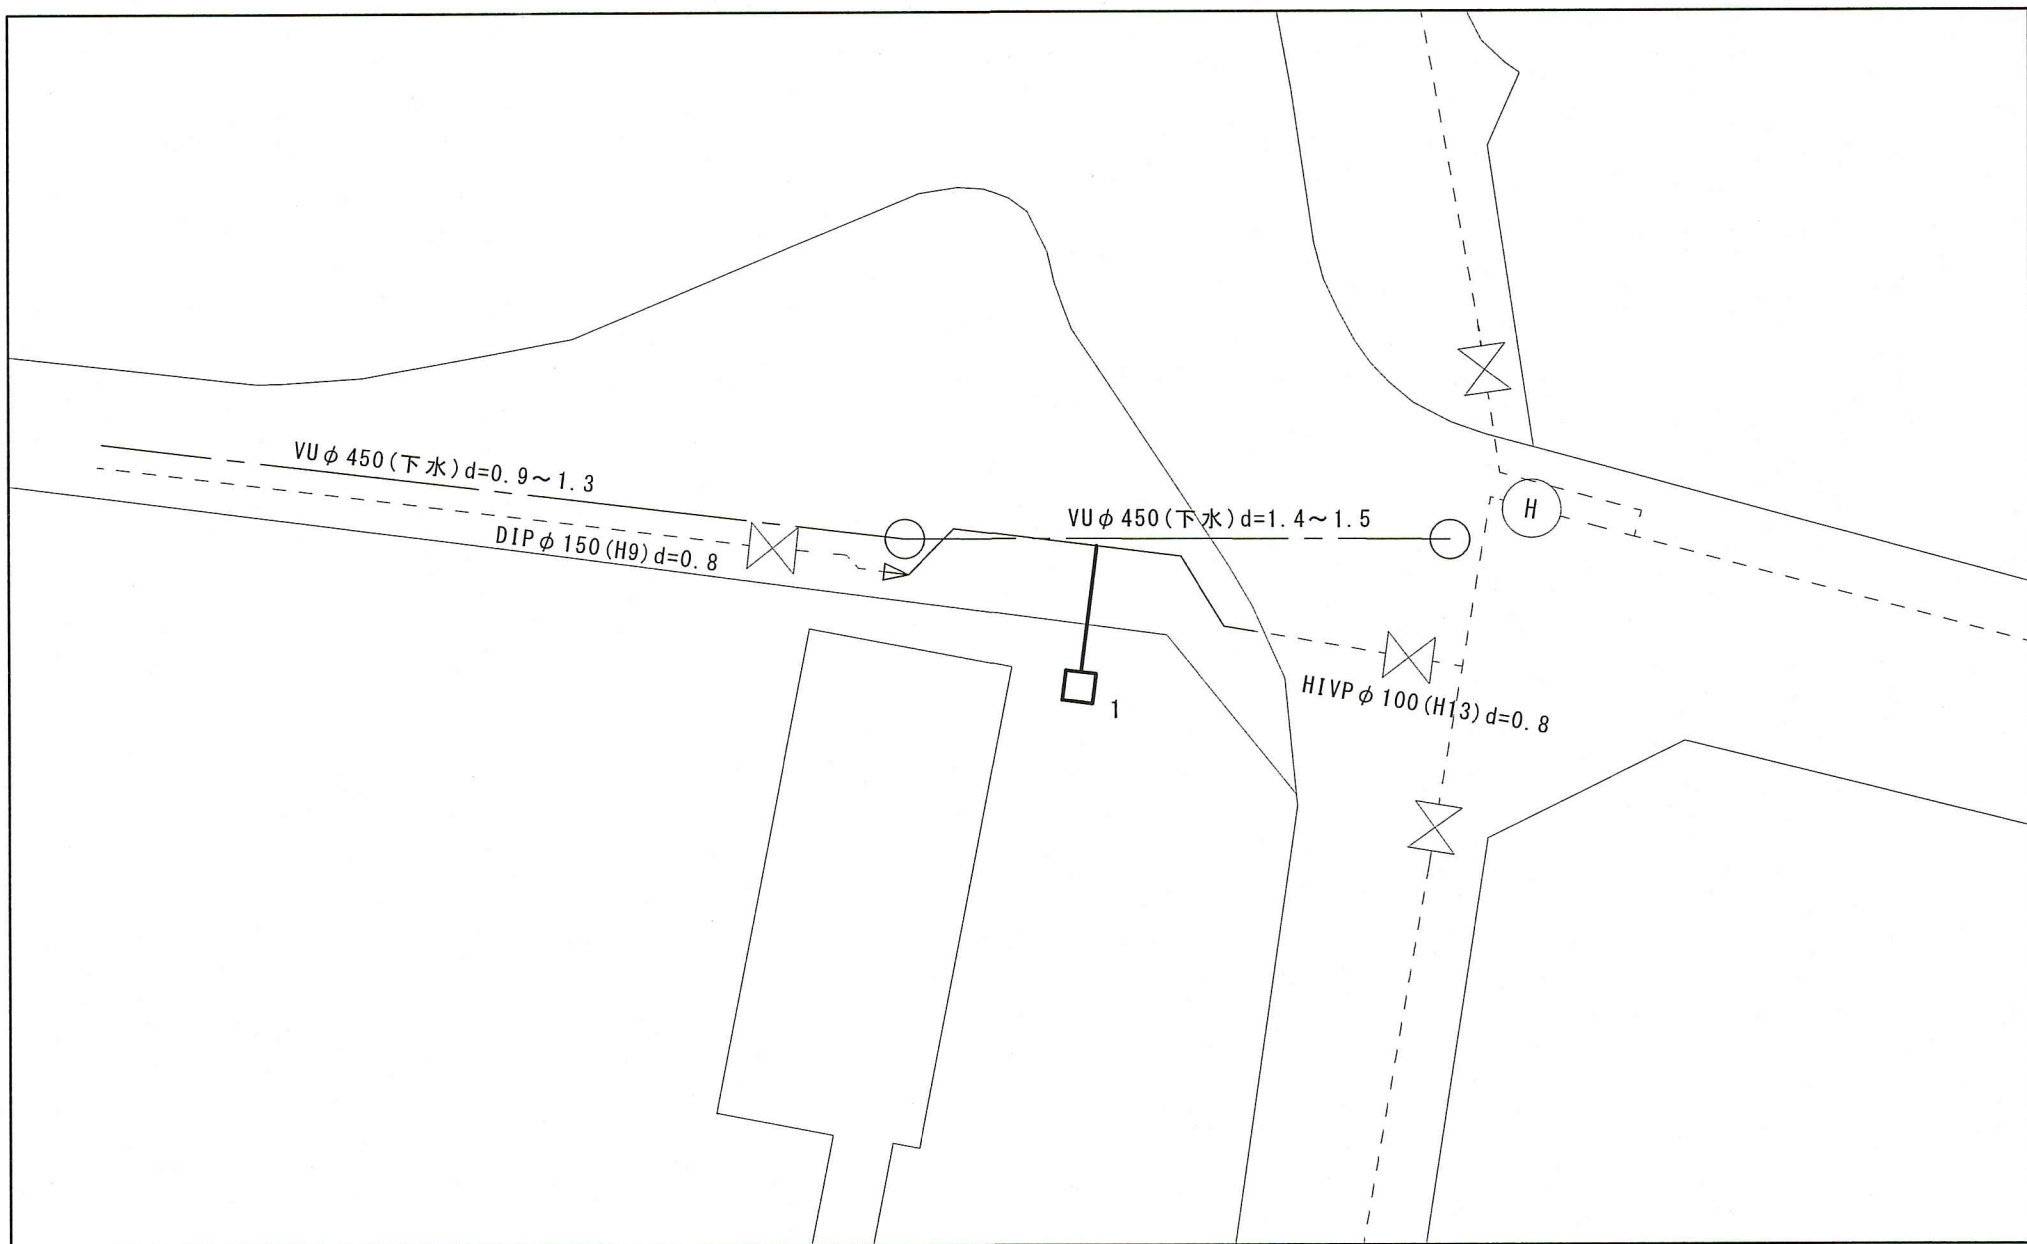

切替断面図 S=1:Free


宅内メーター、宅内止水栓

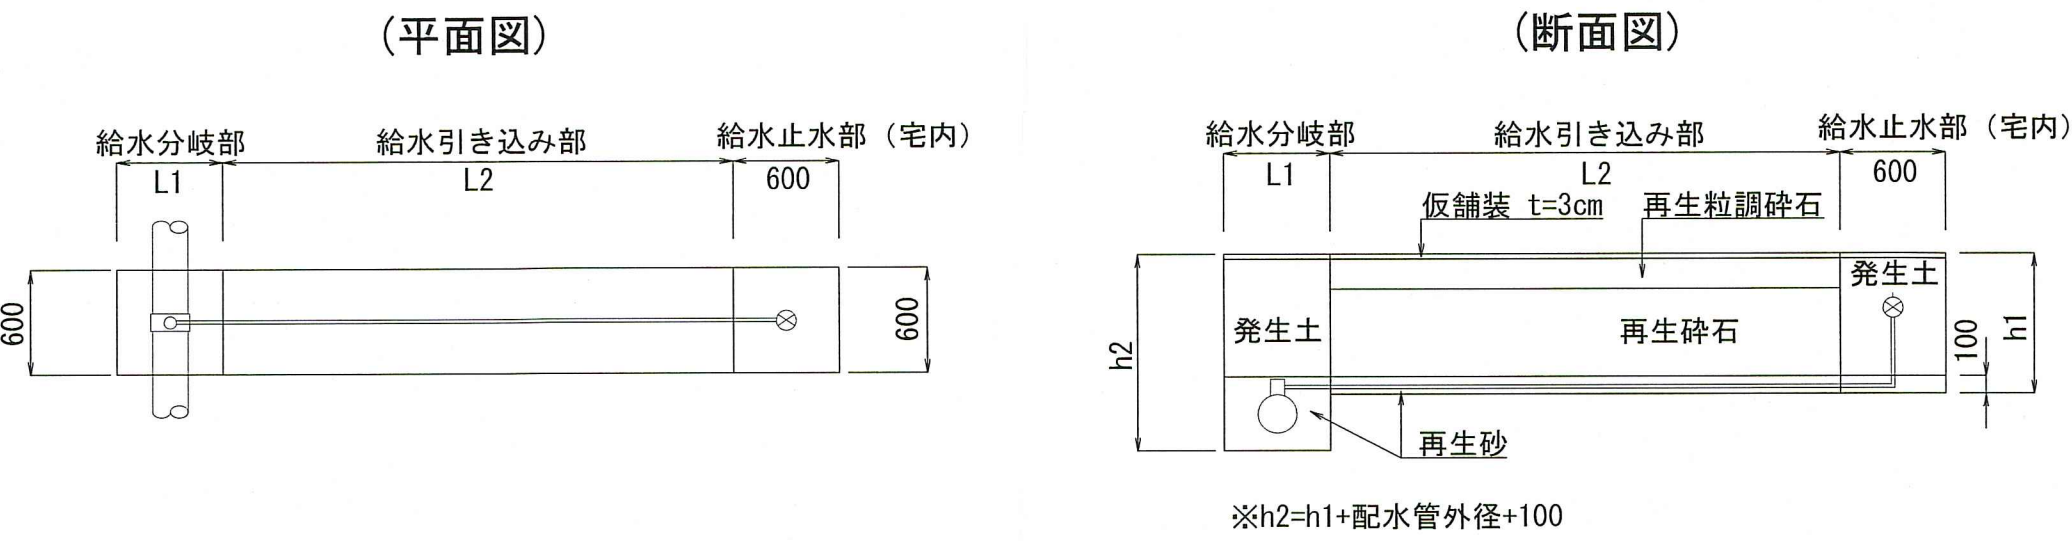

土工定規図 S=1:Free


※再生砕石埋戻しについては、平均粒径(D50)が10mm以上かつ10%粒径が1mm以上の砕石を締固め度90%以上で施工すること。

GX形DIP

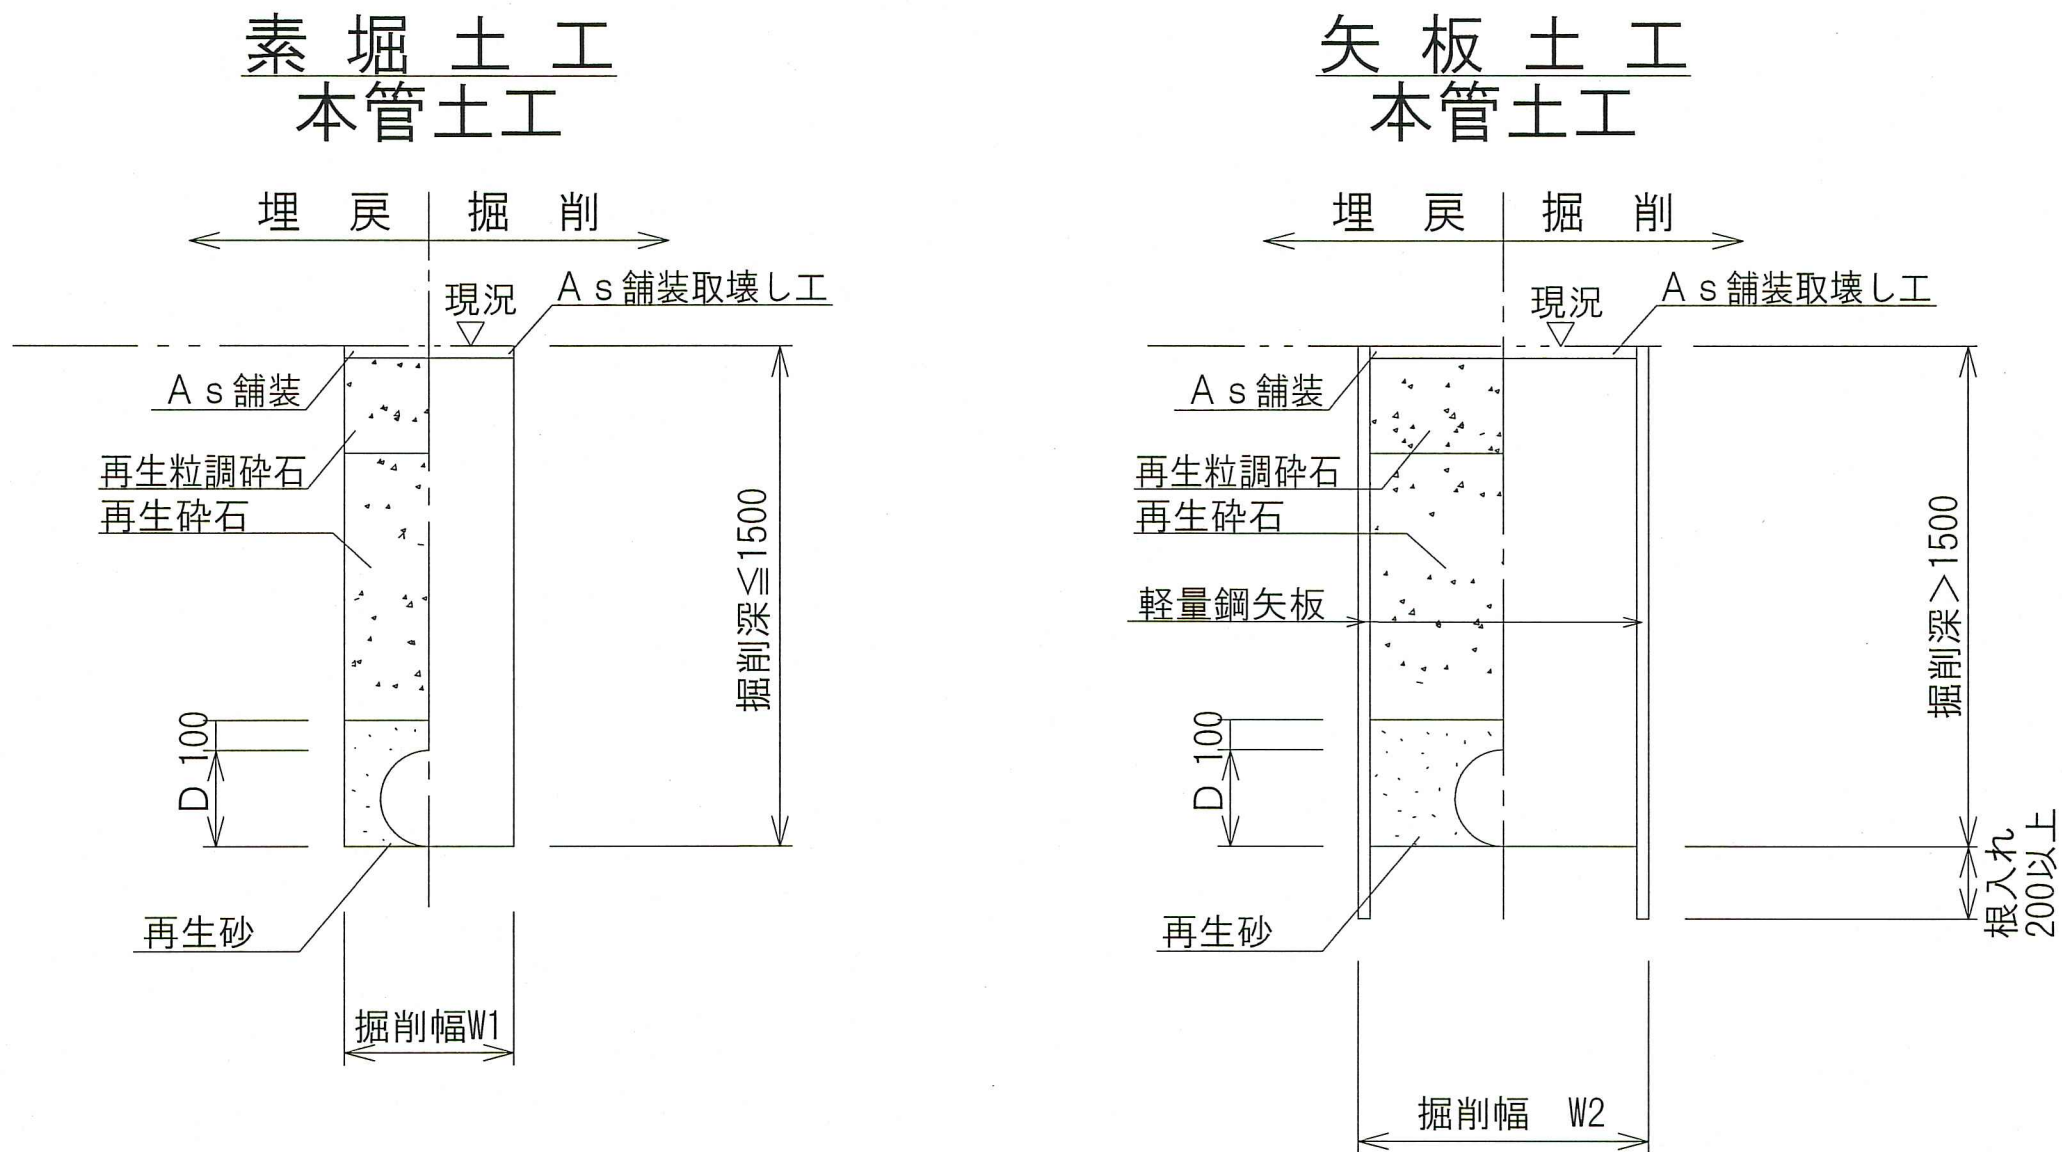


管種	管内径 (mm)	管外径 D (mm)	掘 削 幅	
			W1 (mm)	W2 (mm)
GX形DIP	75	90	600	900
GX形DIP	200	220	600	900
GX形DIP	400	430	950	1000

HIVP

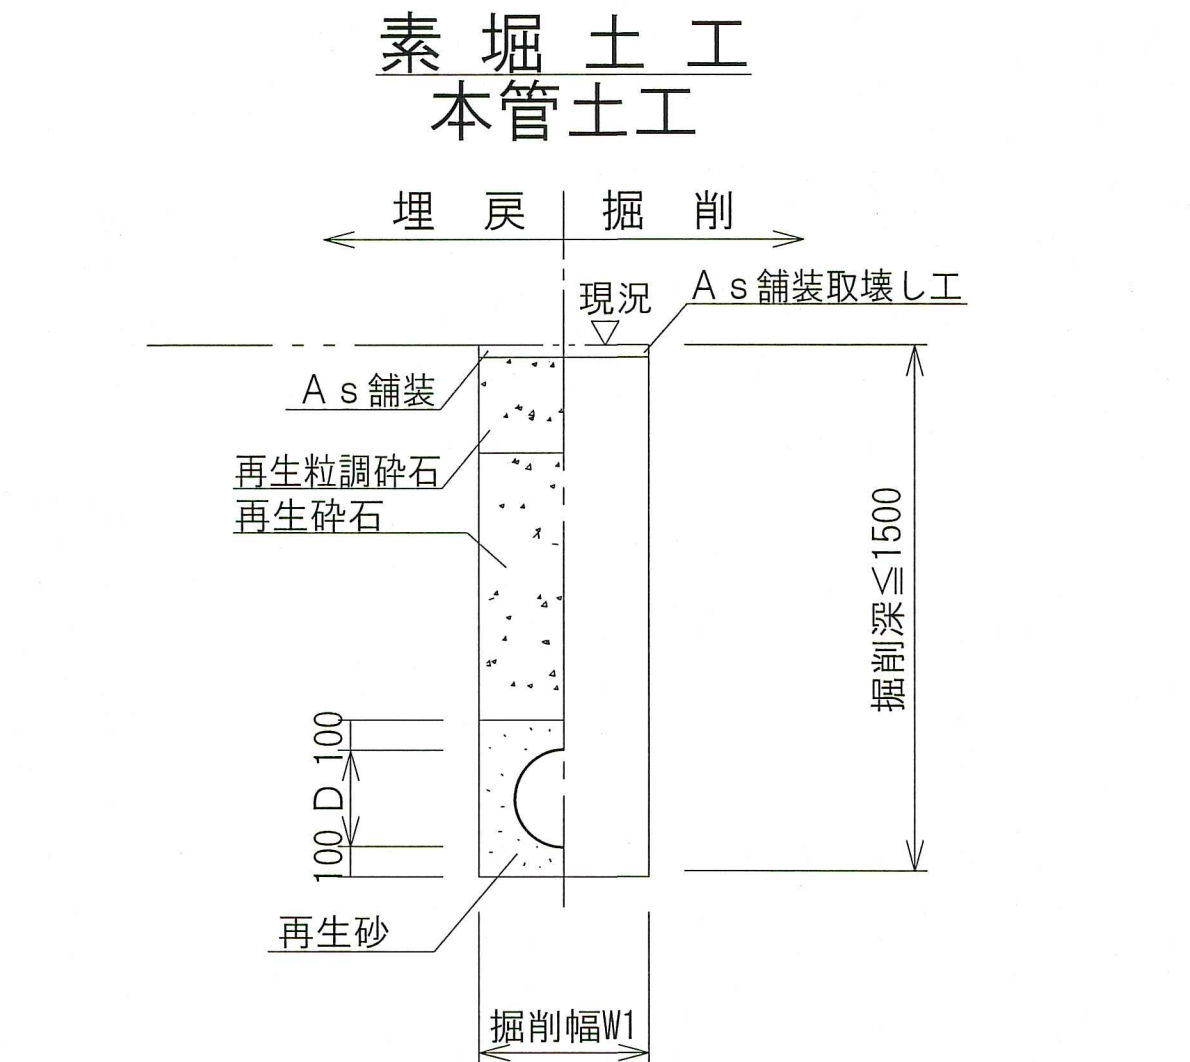


管種	管内径 (mm)	管外径 D (mm)	掘 削 幅	
			W1 (mm)	W2 (mm)
HIVP	100	120	600	-

舗装復旧断面図 S=1:Free

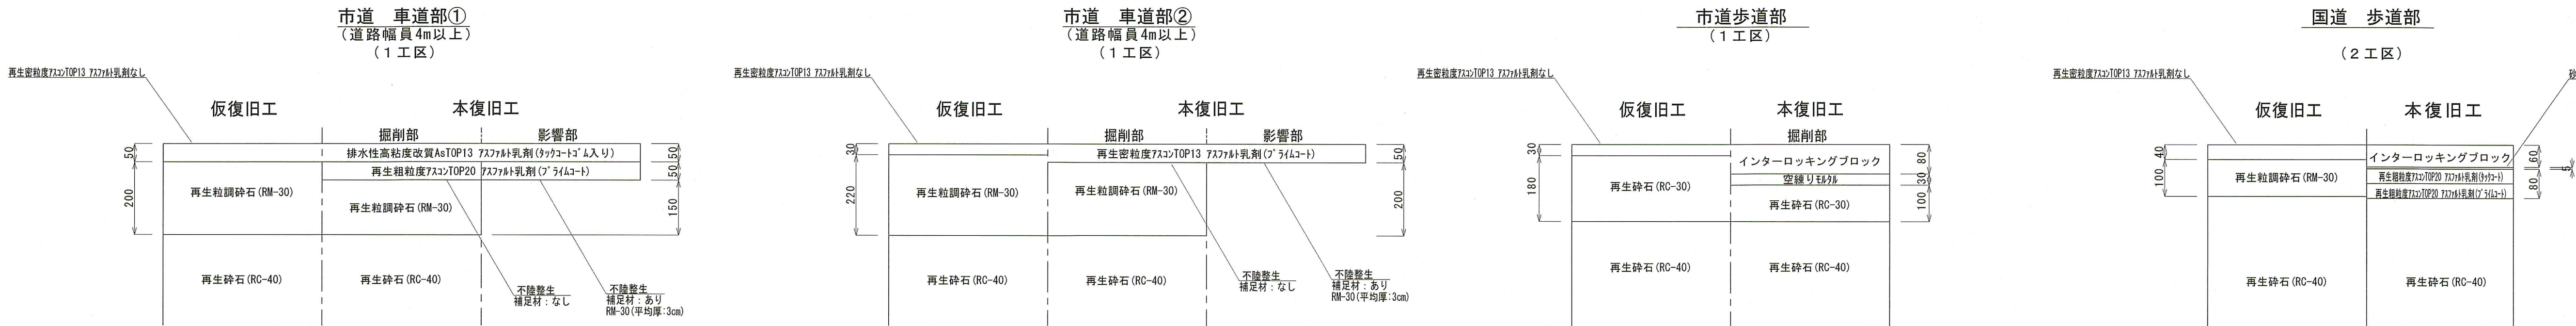


廃止管平面図 S=1:500

(1 工 区)

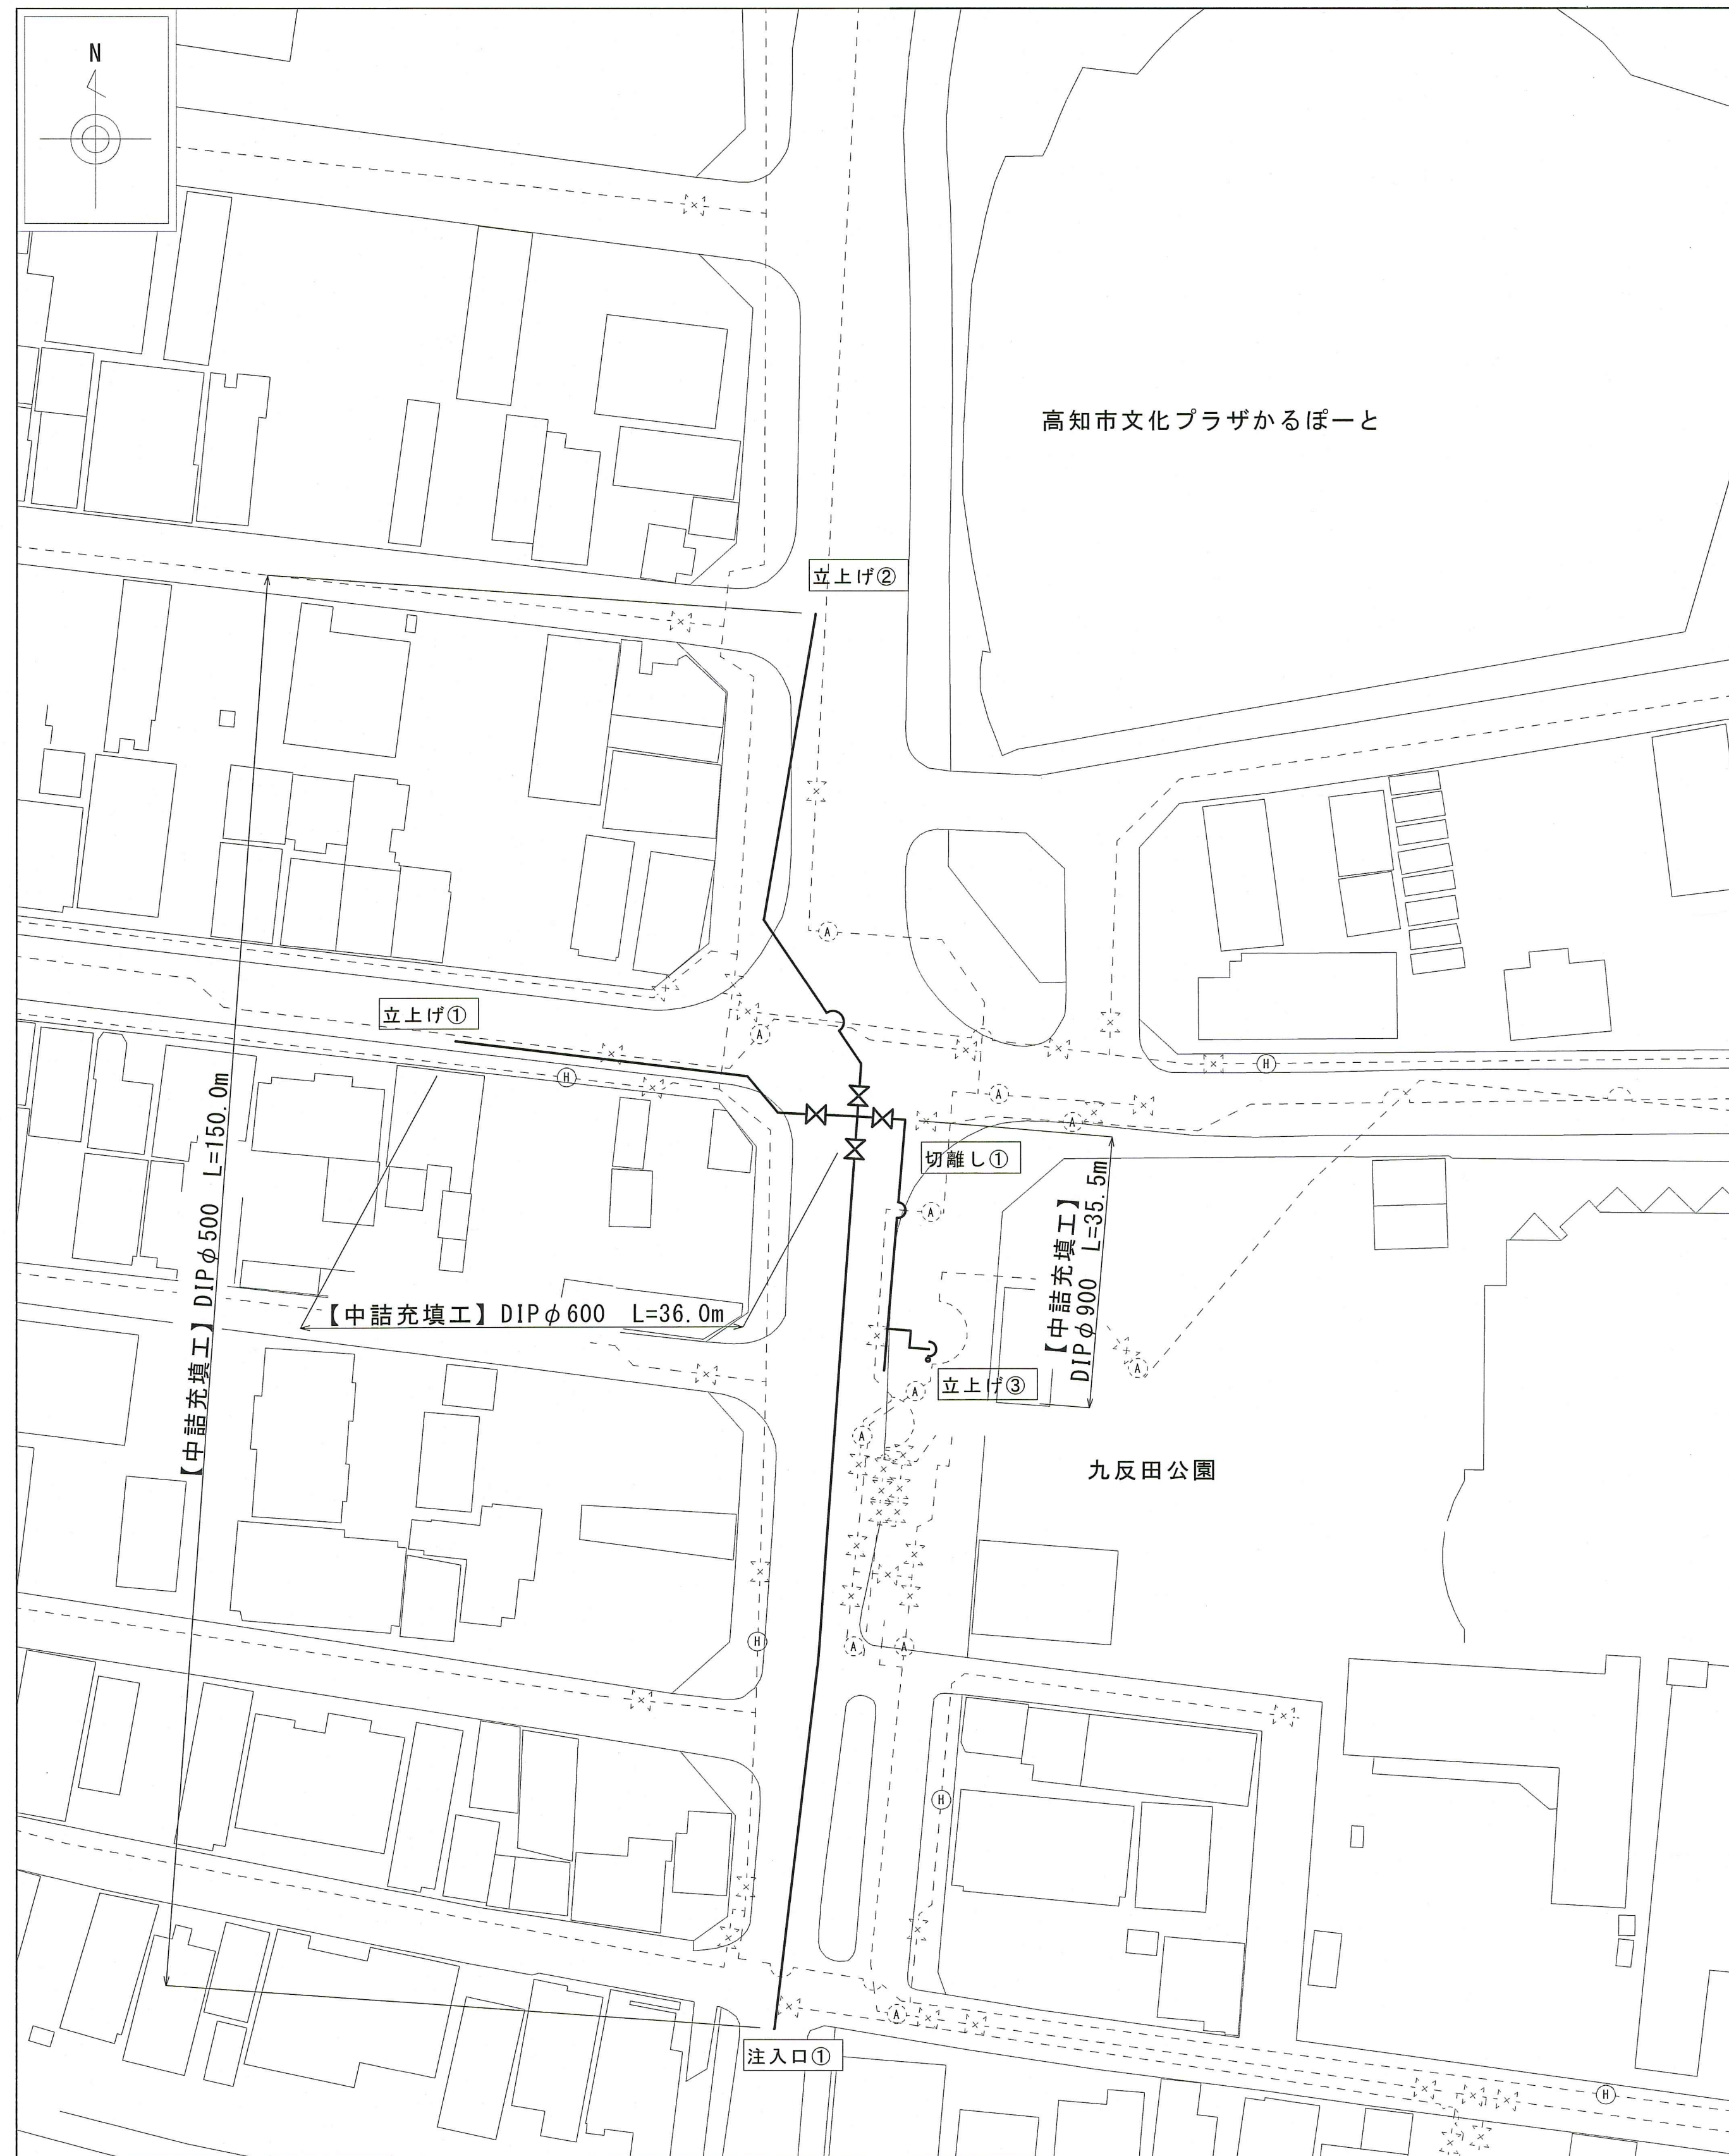

中詰充填工 S=1:Free

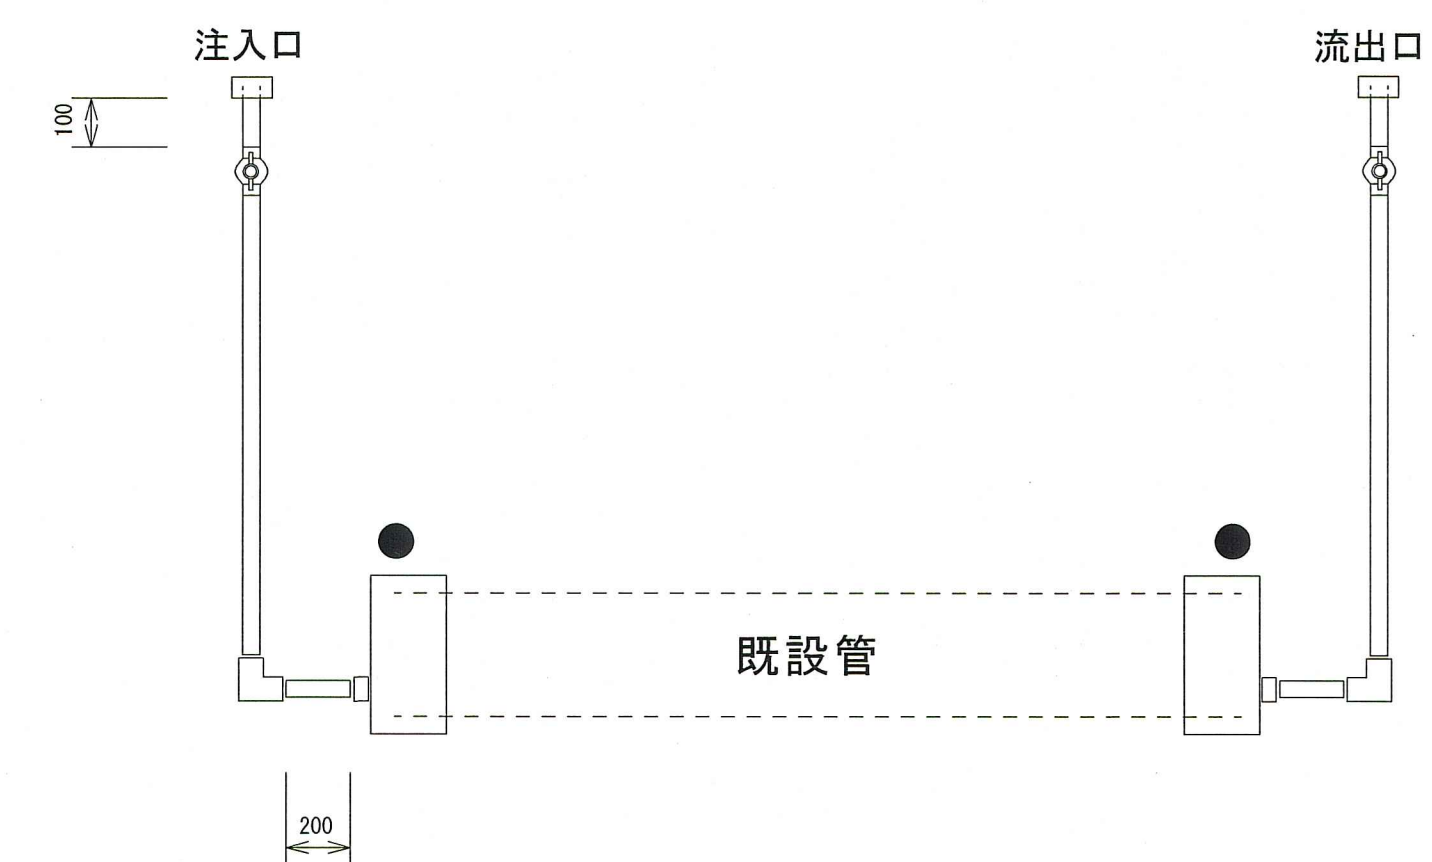

課 長	課長補佐	係 長	設 計
			
九反田外配水本管布設替工事 設計図			令和8年度
			図 4 / 4
			縮 図 示
廃止管平面図・中詰充填工 (1工区)			
高知市 上下水道局 水道整備課			